SURVEY FOR
CLYDE F & PHYLLIS W.
MOWRY

SE 1/4, SEC. 13, TWP. 22, R-20
PLYMOUTH TWP.
RICHLAND CO.
OHIO

● IP Set
O IP, RR Spike Fd.
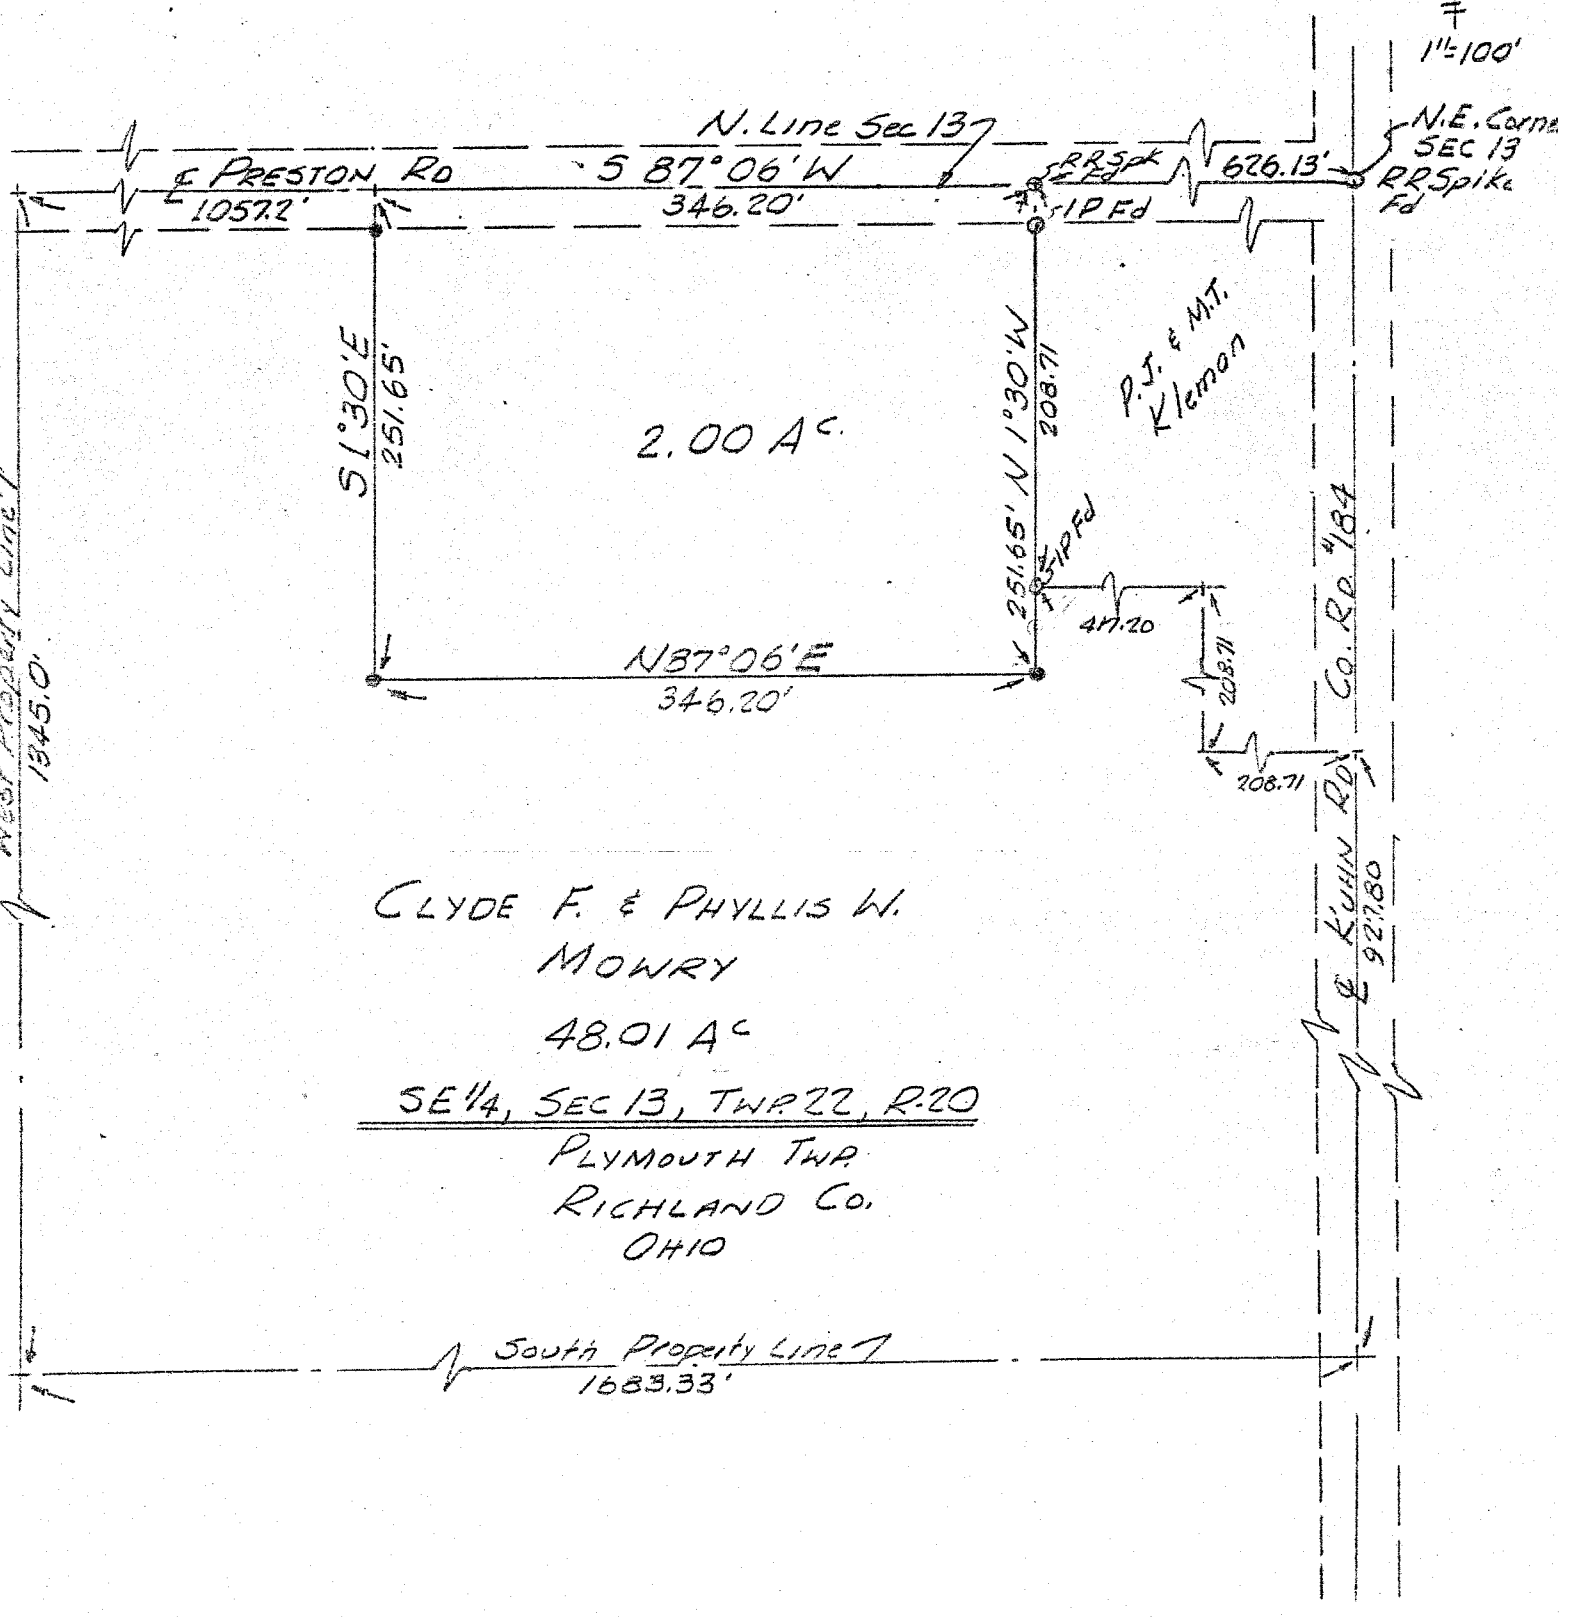
1" = 100'